


INLET

NOTE: SEE NASHVILLE CITY CODE 1947  
CH. 36 SEC P 578 FOR PRESSURE  
REGULATING DEVICE, SAFETY VALVE  
AND CHECK VALVE REGULATIONS

MXU BATTERY PACK  
MUST BE MOUNTED  
ON SIDEWALL OF  
METER BOX

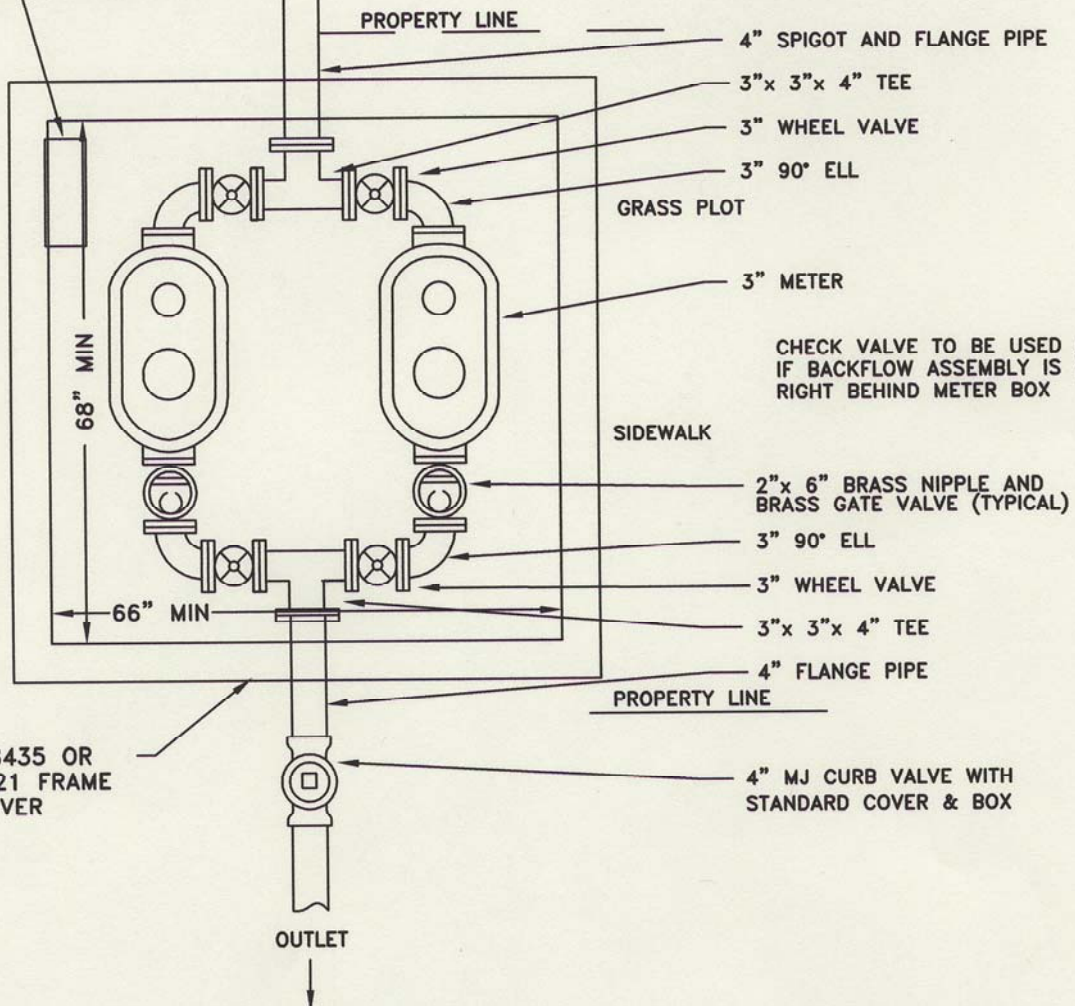

8- V-8435 OR  
JBS 8121 FRAME  
AND COVER

RADIO READ UNIT (MXU) TO BE INSTALLED  
ON SERVICE LINES AS INDICATED BY  
METRO WATER SERVICES PERMIT OFFICE.  
REFERENCE DETAIL WDET002A-1 FOR  
LARGE METER BOX RADIO READ UNIT  
(MXU) CONDUIT AND MOUNTING LOCATIONS.

MXU TO BE INSTALLED AS PER  
MANUFACTURES SPECIFICATIONS.

NOTE: DISTANCE FROM THE TOP OF  
METER TO COVER SHALL NOT  
EXCEED 24"

METRO WATER SERVICES

3" BATTERY METER INSTALLATION  
ON 4" SERVICE

*Hal Balthrop*  
LICENSED DISTRIBUTION OPERATOR

NOT TO SCALE DATE: 2/25/05

DWG. NO. WDET018F

**METRO**  
WATER SERVICES

*[Signature]*  
DIRECTOR OF WATER AND SEWERAGE SERVICES